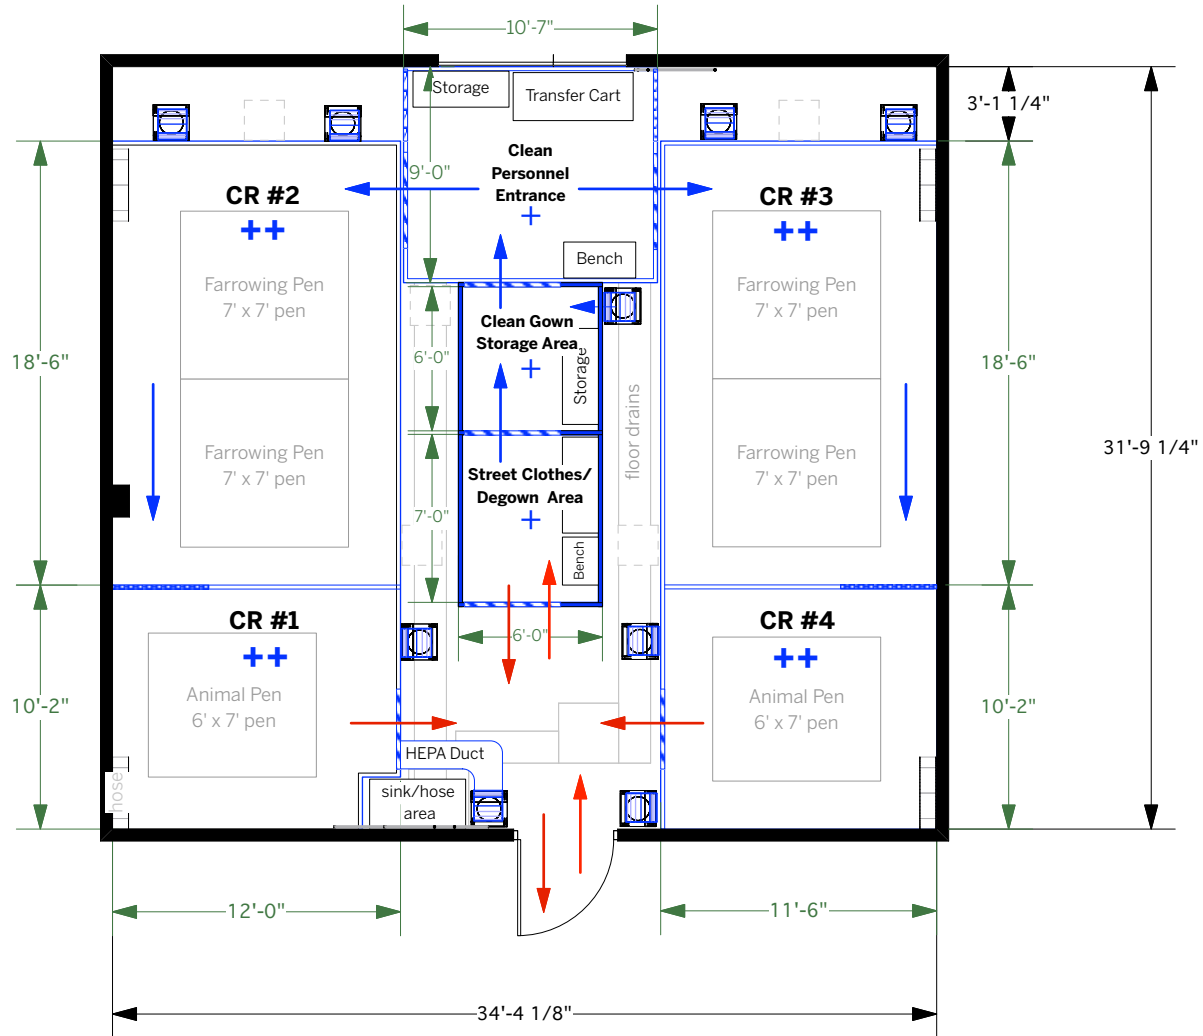# SCID Pig Laboratory
Personnel Flow

9 Power Units
deliver approximately 47 - 53 ACPH
of HEPA filtered air
throughout Clean Room System

Power Units near floor drains
are on 12" elevated bases
for spray downs

CR #2
++
Farrowing Pen
7' x 7' pen

Farrowing Pen
7' x 7' pen

CR #3
++
Farrowing Pen
7' x 7' pen

Farrowing Pen
7' x 7' pen

CR #1
++
Animal Pen
6' x 7' pen

CR #4
++
Animal Pen
6' x 7' pen

Storage

Transfer Cart

Clean Personnel Entrance
+

Bench

Clean Gown Storage Area
+

Storage

Street Clothes/ Degown Area
+

Bench

floor drains

HEPA Duct

sink/hose area

hose

10'-7"
3'-1 1/4"
9'-0"
18'-6"
6'-0"
7'-0"
10'-2"
18'-6"
31'-9 1/4"
10'-2"
6'-0"
12'-0"
11'-6"
34'-4 1/8"

LEGEND

1818 Power Unit

Clean

Potentially Contaminated

48" Strip Door

Environmental Separation Dividers

Clear Vinyl Walls

Power Unit Access

Opaque Walls

Alternate Power Unit Location